


Appendix B(iii) – Shetland as a microcosm of the GB system

Network characteristics comparable to current GB network, at smaller scale \*<sup>□</sup>

0% real time controllable demand

7% renewables

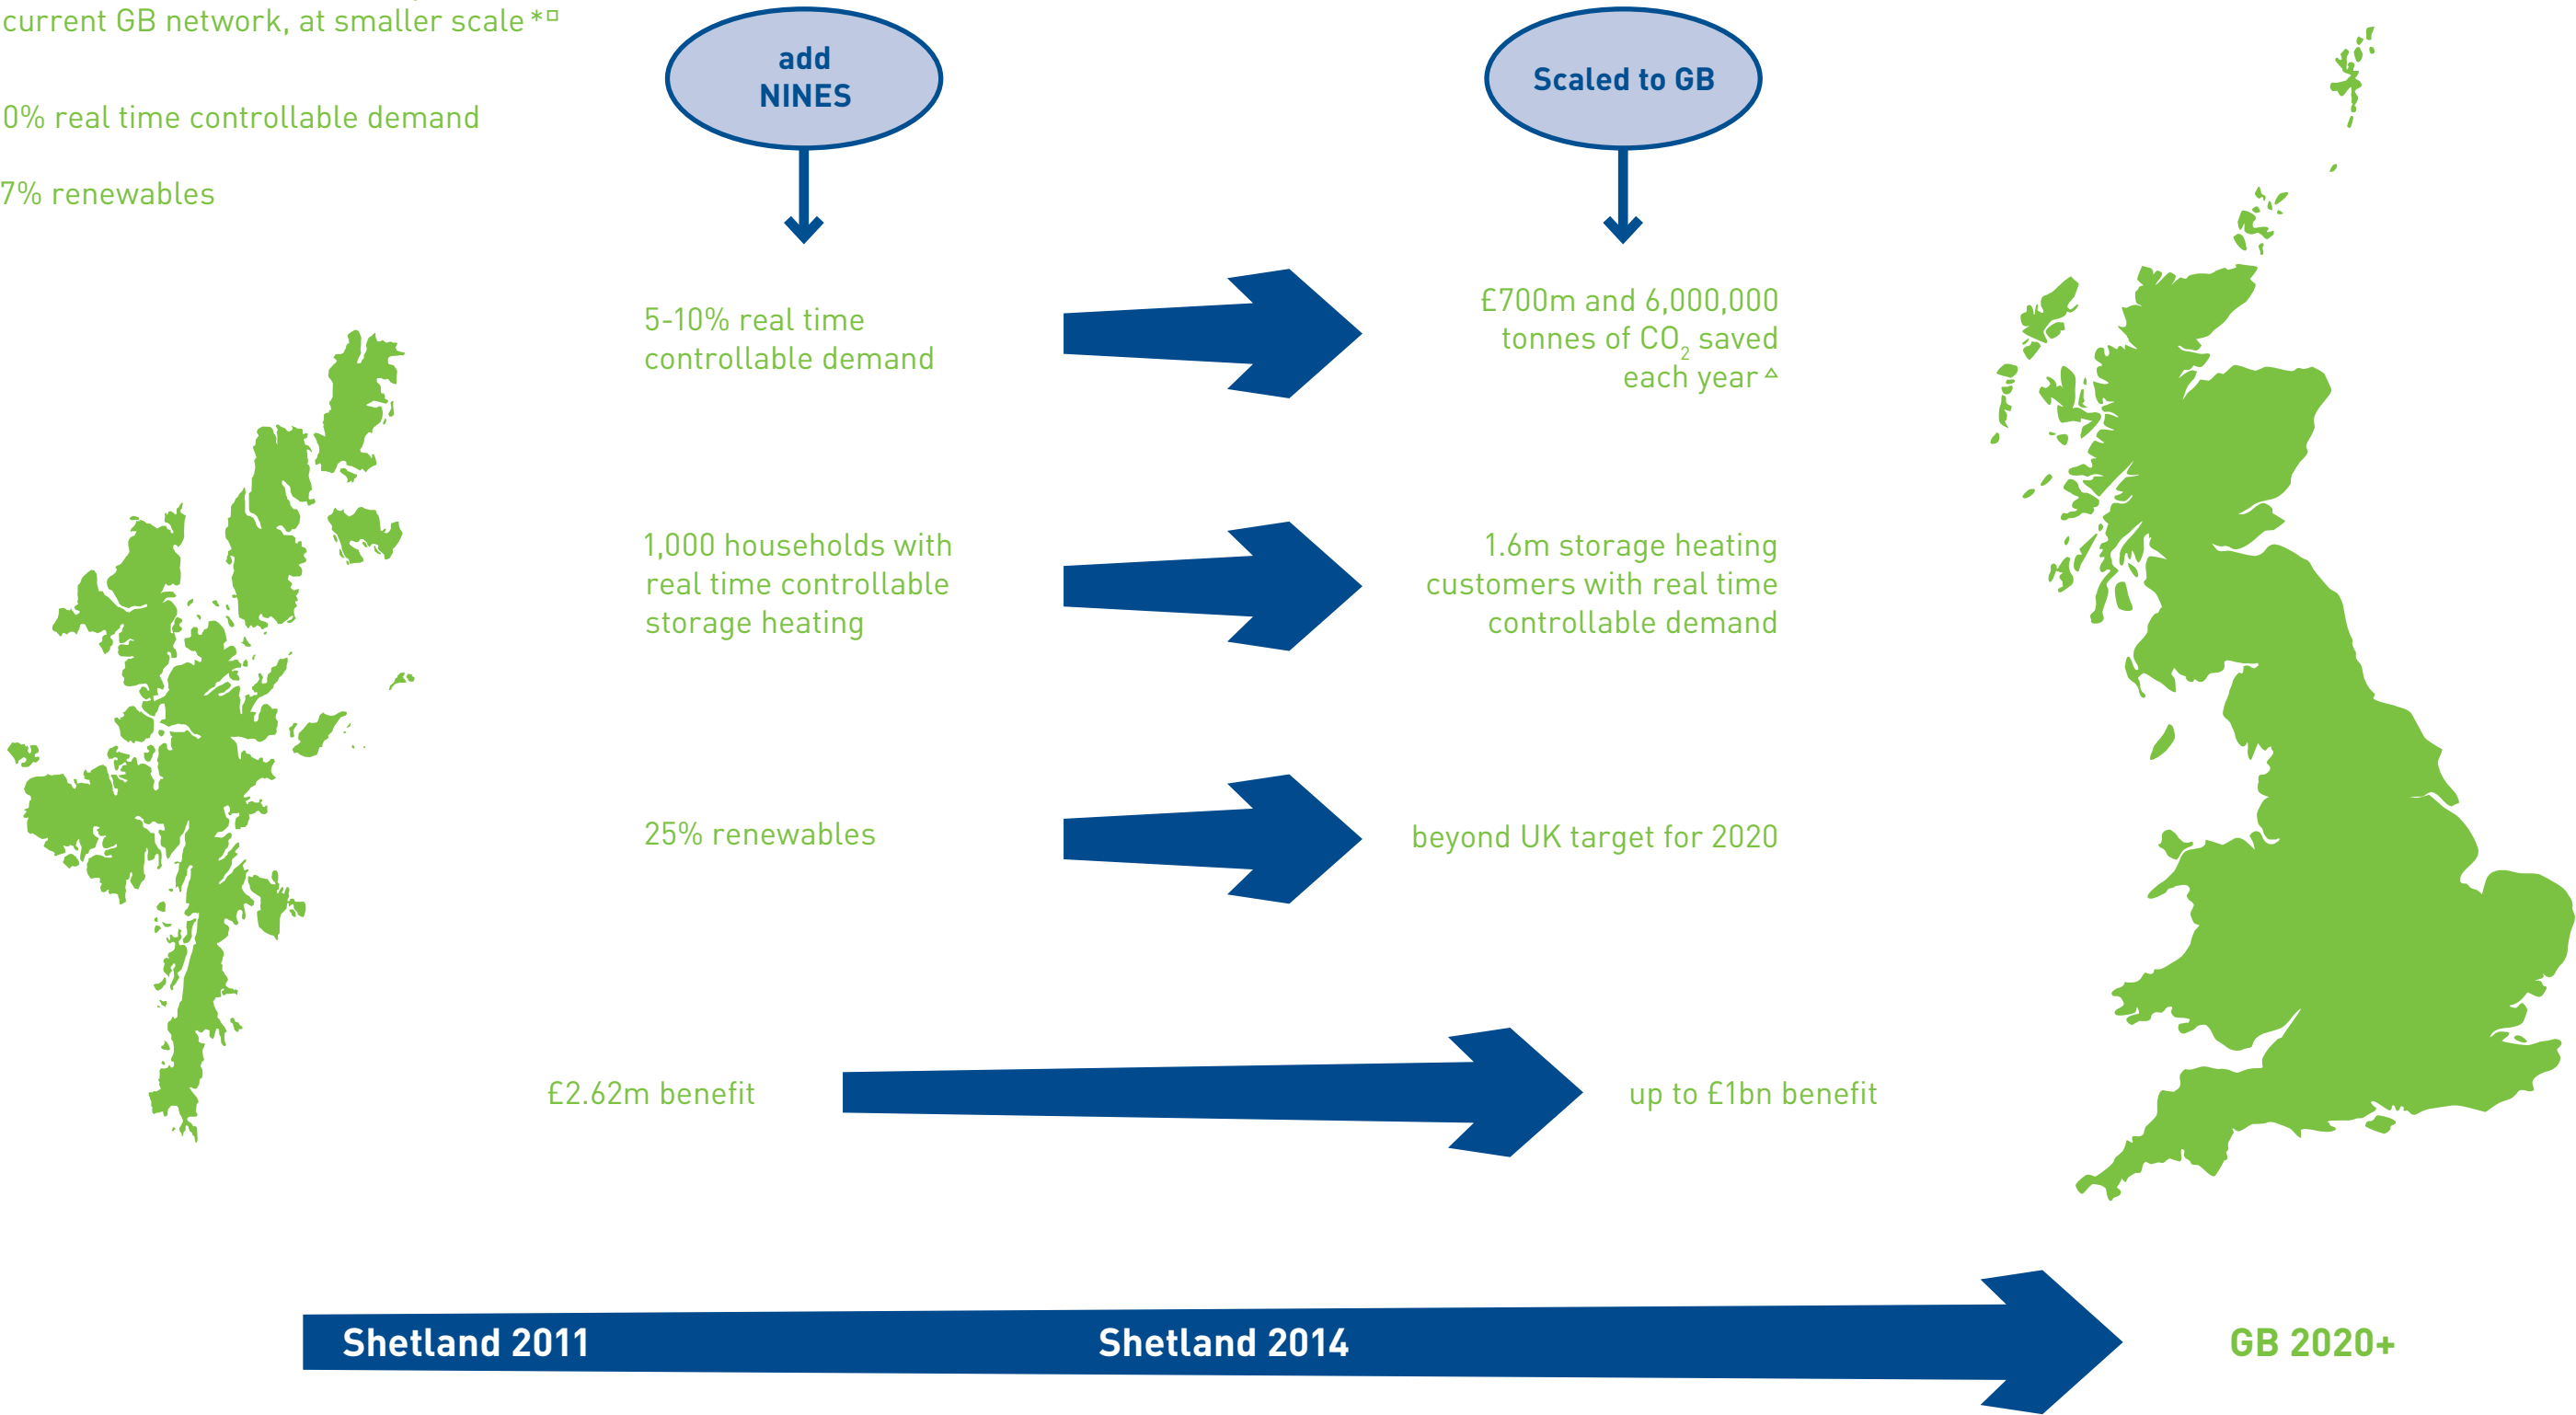

\*National Grid: see Appendices 2 and 3

<sup>□</sup> University of Strathclyde: see Appendix 4

<sup>^</sup> Ofgem: Discussion paper – Demand Side Response July 2015